



European
Commission

Project of common
interest:

4.5.2

PCI fiche

Internal line between Stanisawów and Ostroka (PL)

Baltic Energy Market Interconnection Plan in electricity

CATEGORY
Electricity

CLUSTER
n/a: n/a


COUNTRIES CONCERNED
Poland(PL)

PROMOTERS
PSE S.A. (PL)

PCI WEBSITE(S)
<http://www.pse.pl/>

LOCATION
Stanisawów to Ostroka (PL)

COMMISSIONING DATE
12/2023

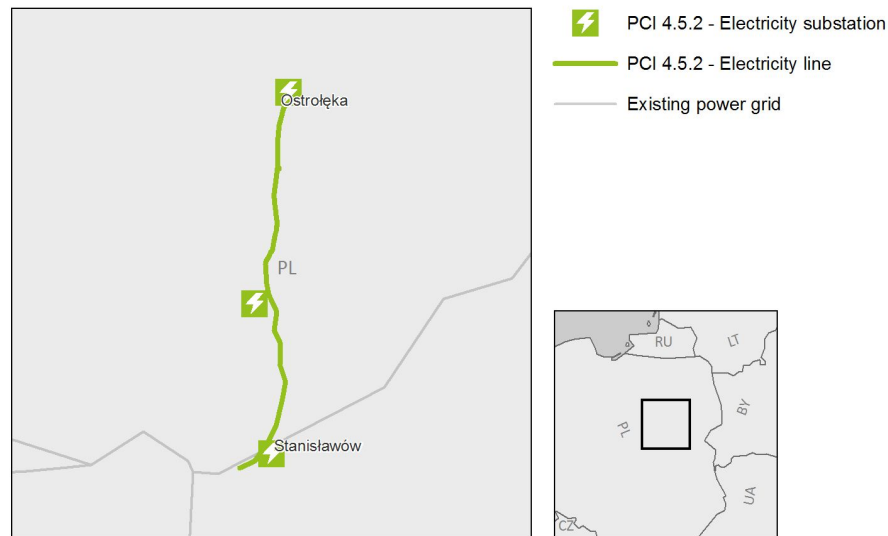

Source: PLATTS, GISCO, European Commission

Technical description

Construction of new 400 kV AC double-circuit OHL line with a length of 108 km and capacity of 2x1870 MVA between Ostroka and Stanisawów. Temporarily, one circuit will use part of the existing 220 kV single-circuit line between Ostroka and Miosna. In one circuit of 400 kV line, the Wyszaków substation will be constructed. After the construction of 400 kV line, the 220 kV line will be disconnected. Extension of 400 kV Ostroka and Stanisawów substations for connection of new Ostroka - Stanisawów line.

CEF funding

4.5.2-0008-PL-S-M-18: Awarded CEF co-funding: 3,489,474 EUR

https://ec.europa.eu/assets/cinea/project_fiches/cef/cef_energy/4.5.2-0008-PL-S-M-18.pdf

LAST UPDATE
March 2023

Energy

Note: In line with the provisions of the TEN-E Regulation, the content of this document relies on information provided by the promoter(s) of the Project of Common Interest and CINEA does not guarantee its accuracy. The European Commission and CINEA accept no responsibility or liability whatsoever with regard to the information contained therein.